

Driver Replacement Procedure for H457ICAT1E Housing

Procédure de remplacement de pilote pour le boîtier H457ICAT1E

Procedimiento para remplazar el controlador del alojamiento H457ICAT1E



WARNING

Risk of Electric Shock

To avoid possible electrical shock, be sure that power supply is turned off at fuse box or circuit breaker before servicing the fixture. Before starting the driver replacement procedure, for your safety read and understand instructions completely.

1. Remove the existing LED Light Engine and disconnect the Halo recessed housing connector.
2. Loosen three screws in the housing collar (Fig. 1).
3. Lower collar (Fig. 2).
4. Disengage inner junction box cover by depressing the retaining spring (Fig. 3).
5. Remove junction box cover (Fig. 4).
6. Replace driver and reinstall.



AVERTISSEMENT

Risque de choc électrique

To avoid possible electrical shock, be sure that power supply is turned off at fuse box or circuit breaker before servicing the fixture. Before starting the driver replacement procedure, for your safety read and understand instructions completely.

1. Retirez le moteur lumineux DEL installé et débranchez le connecteur du boîtier encastré.
2. Dévissez les trois (3) vis du collier du boîtier (III. 1).
3. Abaissez le collier (III. 2).
4. Délogez le couvercle interne de la boîte de jonction en appuyant sur les ressorts de retenue (III. 3).
5. Retirez le couvercle de la boîte de jonction (III. 4).
6. Remplacez les circuits électroniques et réinstallez.



ADVERTENCIA

Riesgo de descarga eléctrica

To avoid possible electrical shock, be sure that power supply is turned off at fuse box or circuit breaker before servicing the fixture. Before starting the driver replacement procedure, for your safety read and understand instructions completely.

1. Retire el motor de luz LED existente y desconecte conector del alojamiento empotrado Halo.
2. Afloje tres tornillos en el cuello del alojamiento (Fig. 1).
3. Collar inferior (Fig. 2).
4. Desacople la cubierta de la caja de empalmes presionando el resorte de retención (Fig. 3).
5. Retire la cubierta de la caja de empalmes (Fig. 4).
6. Reemplace el controlador y vuelva a instalar.

Figure 1

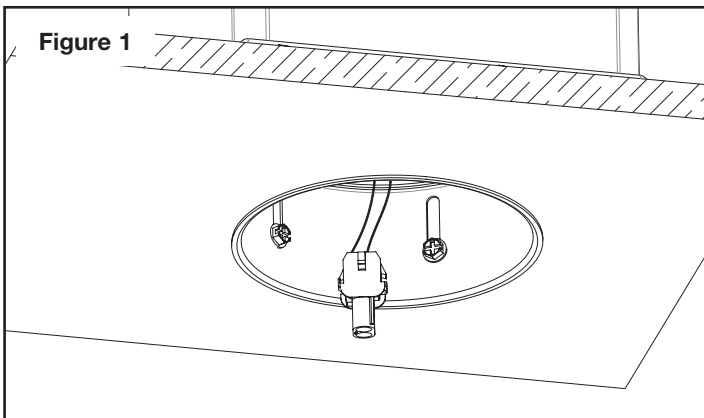


Figure 2

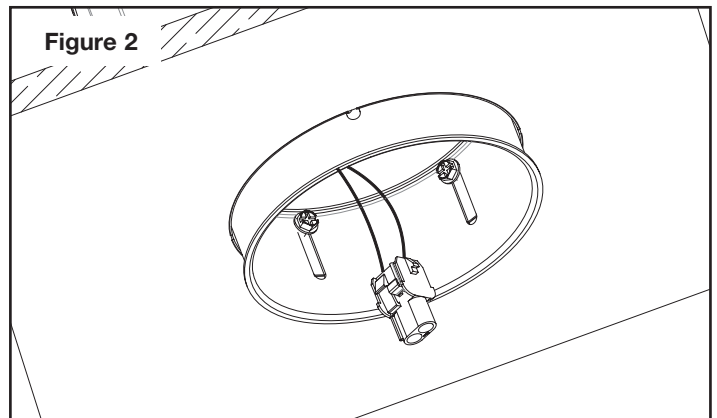


Figure 3

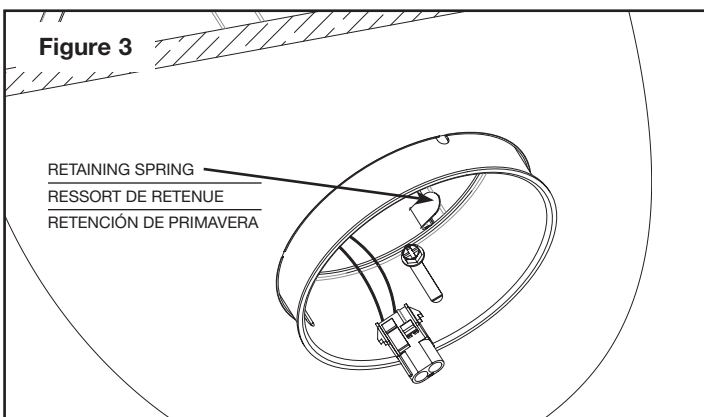


Figure 4

